

OHIO CENTRAL-MILLWOOD TRANSMISSION LINE REBUILD PROJECT

AEP Ohio representatives plan power grid upgrades to improve electric reliability for customers in Knox, Coshocton and Muskingum counties. The Ohio Central - Millwood Transmission Line Rebuild Project involves updating about 28 miles of power line.

WHAT

The project involves rebuilding about 28 miles of 138-kilovolt power line between Ohio Central and Millwood substations.

*This project requires regulatory filings with the Ohio Power Siting Board (OPSB)

WHY


The improvements:

- Upgrade aging towers from the 1920s with modern steel poles
- Strengthen the local electric transmission system
- Reduce the likelihood of power outages
- Speed recovery of service when outages occur


WHERE

The project area includes:

- Howard, Union, Butler and Jackson townships in Knox County
- Perry, Pike and Washington townships in Coshocton County
- Cass and Jefferson townships in Muskingum County

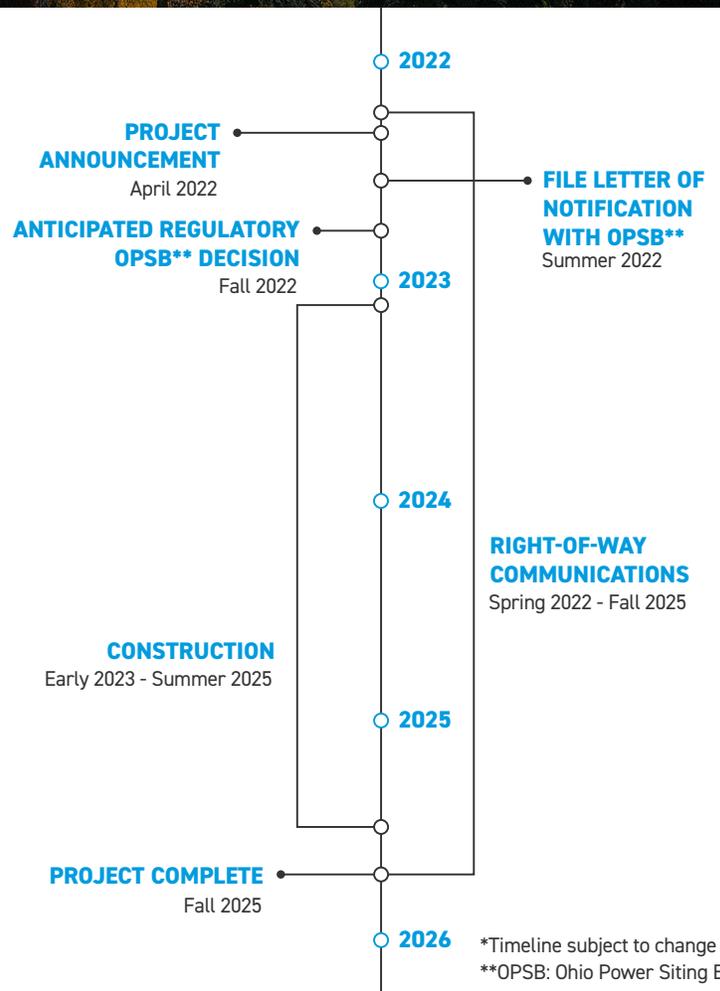

*Timeline subject to change
 **OPSB: Ohio Power Siting Board

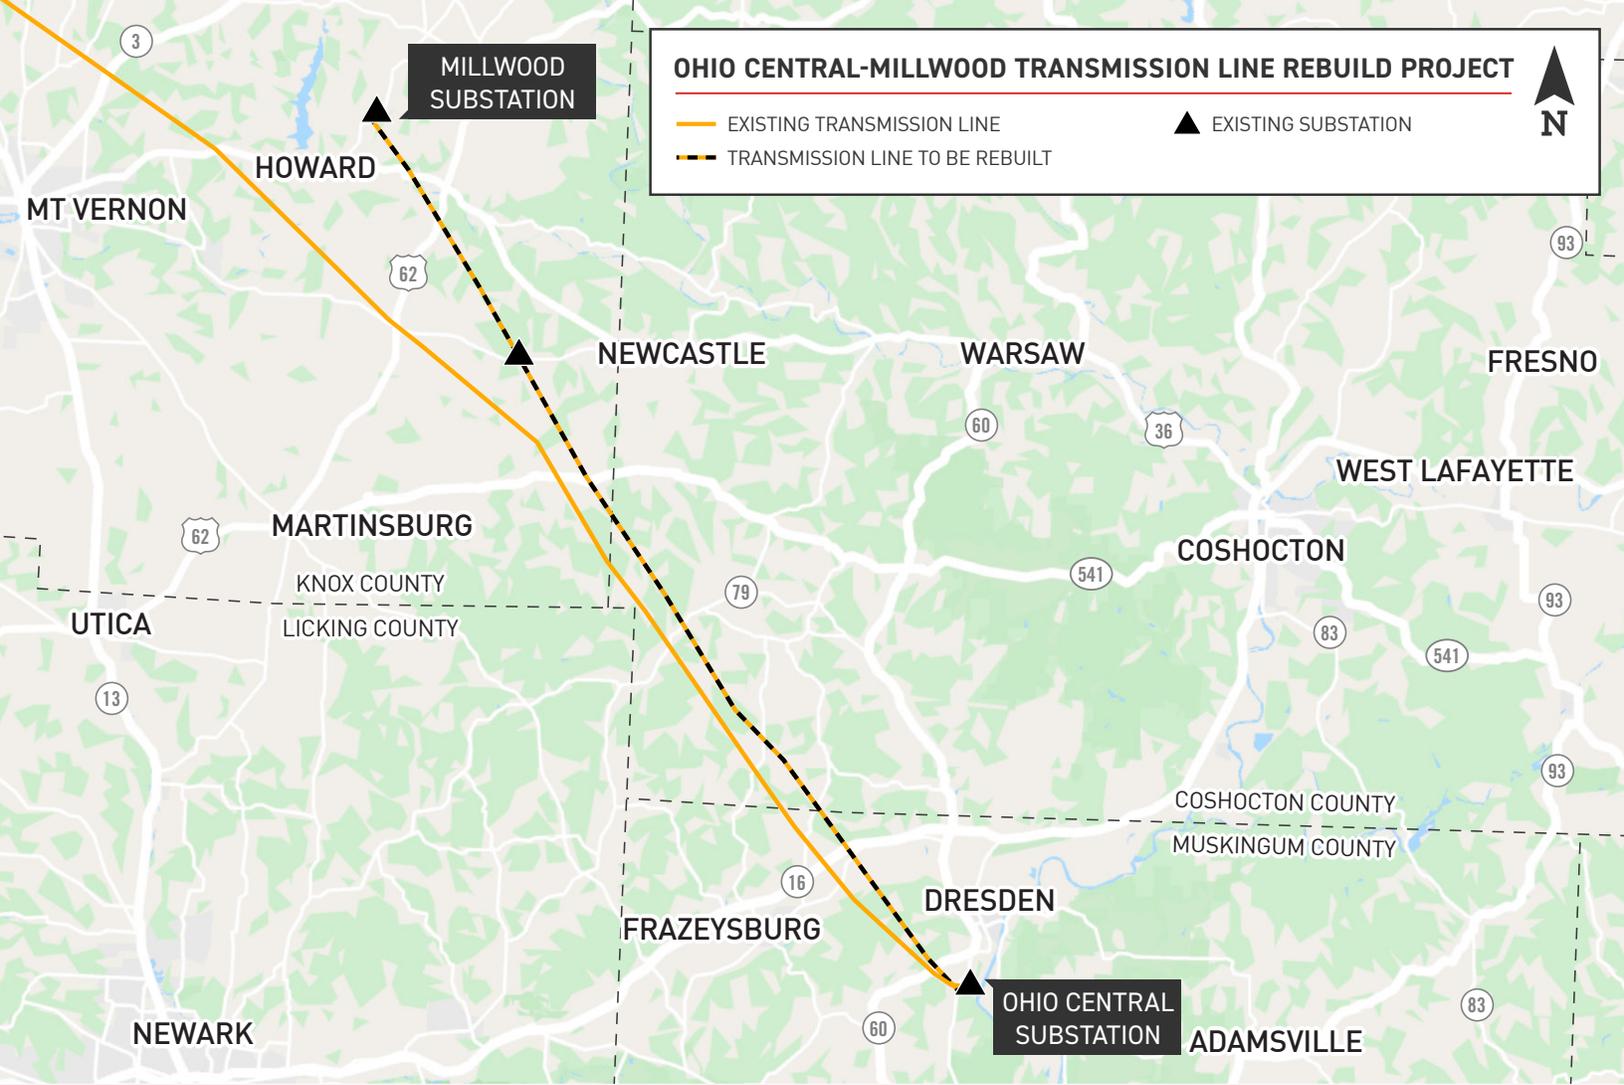


TYPICAL STRUCTURES

The project involves the use of steel single-pole structures.

Structure Height: Approximately 100 feet*

Right-of-Way Width: 100 feet*

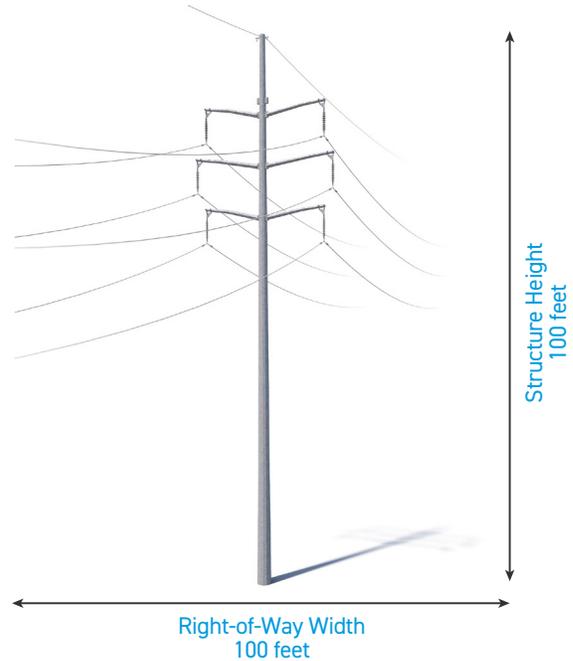

*Exact structure, height, and right-of-way requirements may vary.

WE VALUE YOUR INPUT. PLEASE SEND COMMENTS AND QUESTIONS TO:

AEP OHIO OUTREACH TEAM

AEP OHIO_OUTREACH@AEP.COM • 614-933-2998

AEP OHIO.COM/MILLWOOD



06/21/2024