

Naismith Transmission Line Project

AEP Texas representatives plan to improve electric reliability in San Patricio County.

What

The project involves building two new 138-kilovolt transmission lines approximately 3 miles and upgrading equipment at the Naismith Substation.

AEP Texas officials plan to file a Certificate of Convenience and Necessity (CCN) application with the Public Utility Commission of Texas (PUC) following a review of public input on route link development and additional route analysis. Project representatives expect to file a CCN application by early 2027. The final line route is determined by the PUC.


Why

The project provides additional electrical capacity to support the area's future growth and development.

Where

The project area includes the City of Gregory in San Patricio County.

Project Schedule

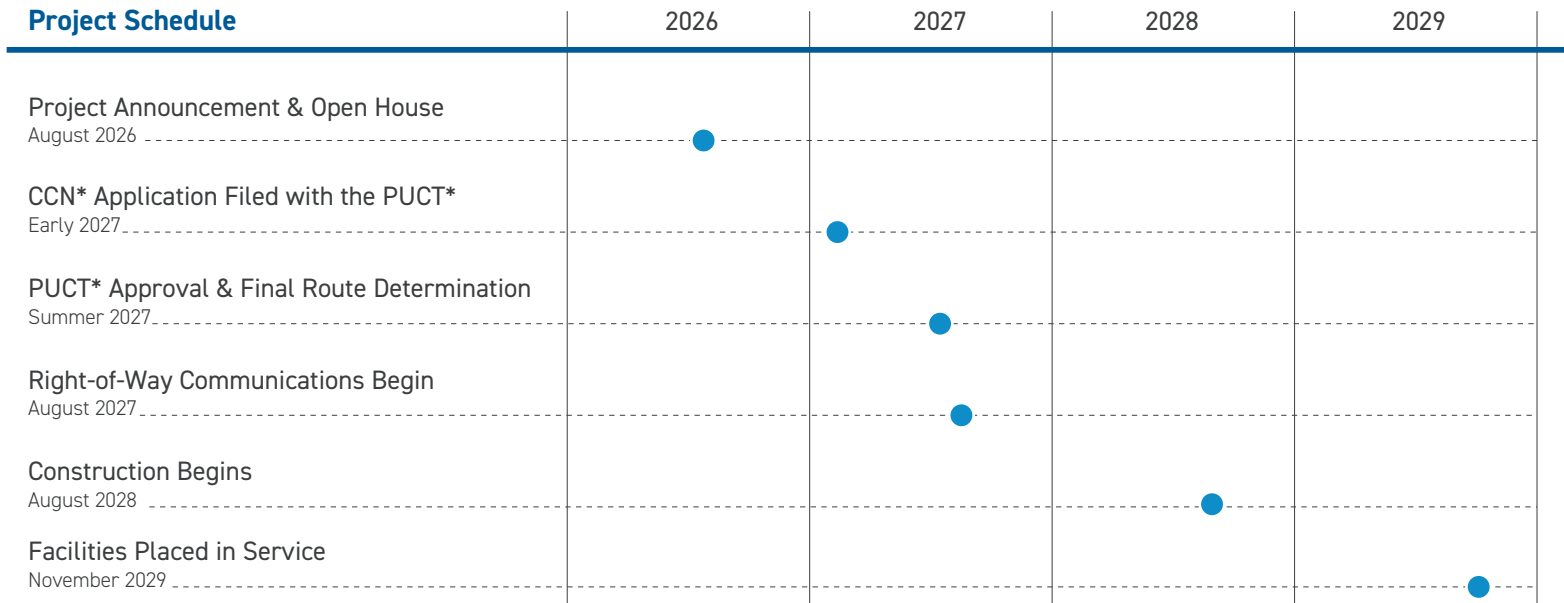


*CCN: Certificate of Convenience and Necessity; PUCT: Public Utilities Commission of Texas

**Timeline Subject to Change

Legend

- Preliminary Links
- 00 Preliminary Link Labels
- Point of Interconnection
- ▲ Substation to be Upgraded

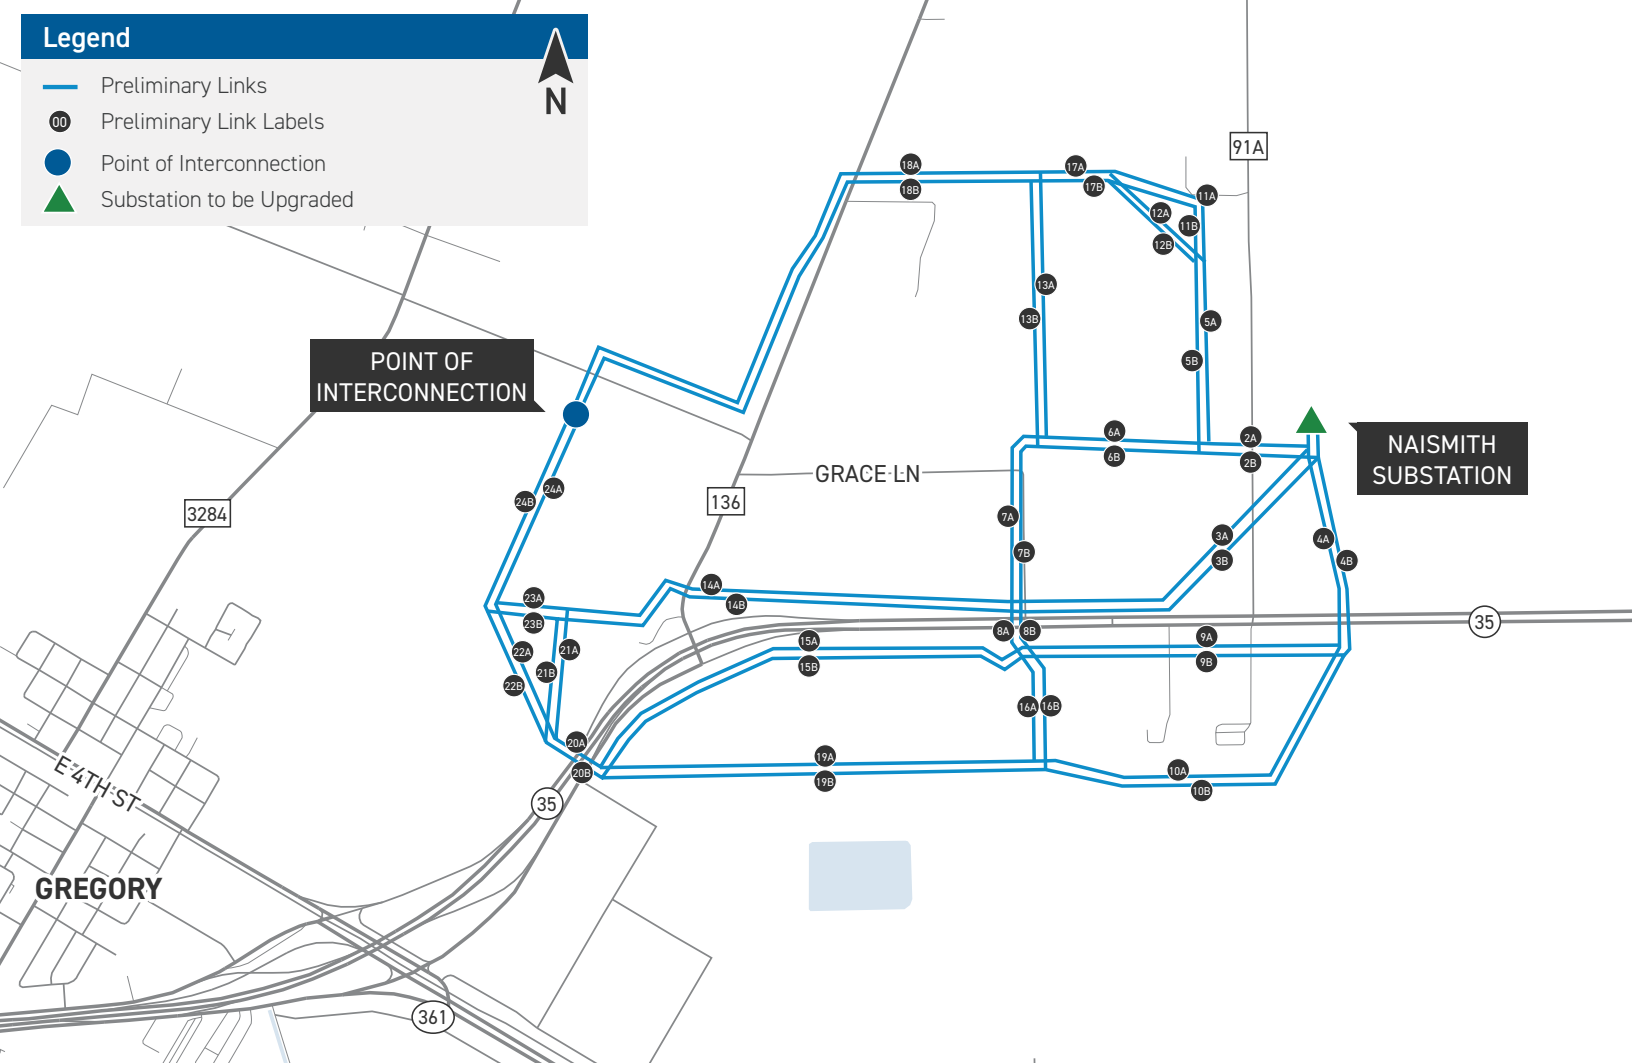

Typical Structures

Typical Structure Height: 80 feet
 Typical Distance Between Structures: 600 feet
 Typical Right-of-Way Width: 100 feet



80
feet tall

**Exact structure, height, and right-of-way requirements may vary.*



We value your input. Please send comments and questions to:

Kimberly Sanchez • Project Outreach Specialist
 AEPTexasOutreach@aep.com • 833-329-4865

AEPTexas.com/Naismith

7/27/2026